


1. Water main should cross above other pipe. When water main must be below other pipe, the minimum separation is 12 inches.
2. Reclaimed water regulated under Part III of Chapter 62-610, F.A.C.
3. 3 Ft. for gravity sanitary sewer where the bottom of the water main is laid at least 6 inches above the top of the gravity sanitary sewer.
4. Reclaimed water not regulated under Part III of Chapter 62-610, F.A.C.

Disclaimer - This document is provided for your convenience only. Please refer to F.A.C. Rule 62-555.314 for additional construction requirements.

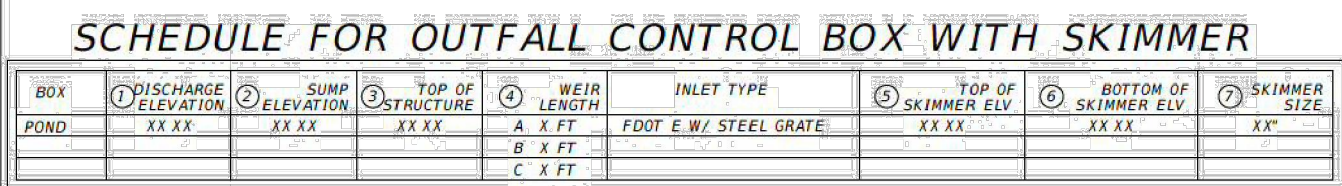

- NOTES**

 1. MANHOLE COVER SHALL BE LETTERED WITH THE WORDS "SANITARY SEWER" AND THE YEAR THE MANHOLE WAS CONSTRUCTED
 2. CITY OF OCALA IDENTIFICATION LABEL SHALL BE BOLTED ON COVER.
 3. UNLESS OTHERWISE SPECIFIED MANHOLE COVERS SHALL BE 24" DIAMETER AND 32" DIAMETER DEPENDING ON DEPTH.
 4. ALL MANHOLE COVERS SHALL BE FURNISHED WITH HINGES AND LOCKING DEVICE.
 5. WHERE MANHOLE COVERS ARE NOT INSTALLED IN CENTER OF TWO WAY TRAFFIC, HINGED SIDE OF COVER TO BE INSTALLED TOWARDS INCOMING TRAFFIC.
 6. STANDARD: USE ON ALL MANHOLES.



MANHOLE BASES SHALL BE FORMED OF CLASS I CONCRETE WHILE THE MANHOLES ARE UNDER CONSTRUCTION.



811 KNOW WHAT'S BELOW
ALWAYS CALL 811
BEFORE YOU DIG

It's fast. It's free. It's the law.

www.callsunshine.com

BID SET
04/20/2022

PROJECT No.:	FT20003
DRAWN BY:	AAH
CHECKED BY:	EMM
DATE:	03/17/202
SCALE:	AS NOTED
CAD I.D.:	FT200034 - OCALA UTIL

PROJECT:

ROOMS TO GO
S.W. COLLEGE ROAD
S.E. 27th AVE


**PERIMETER
DEVELOPMENT, LLC**

2800 & 2832 COLLEGE ROAD
CITY OF OCALA
MARION COUNTY, FLORIDA



1502 W. FLETCHER AVE, SUITE 101
TAMPA, FLORIDA 33612
Phone: (813) 379-4100
Fax: (813) 379-4040
www.ThomasEngineeringGroup.com

www.ThomasEngineeringGroup.com

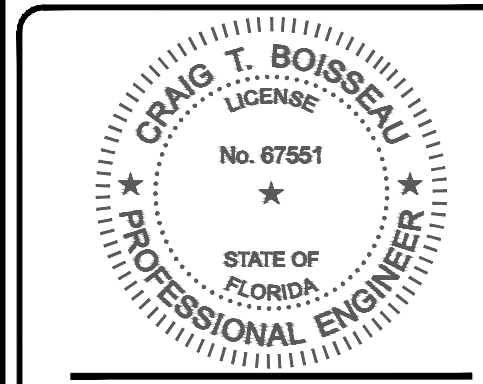

CRAIG T. BOISSEAU, P.E.
April 19, 2022
FLORIDA LICENSE No. 67551
FLORIDA BUSINESS CERT. OF AUTH. No. 2752

SHEET TITLE:
**CITY OF OCALA
DETAILS**

SHEET NUMBER:
C-9
OF