


No.	Description	Date
C	CODE RESPONSE	12/13/21
1	CHANGE BULLETIN 12	07/11/23

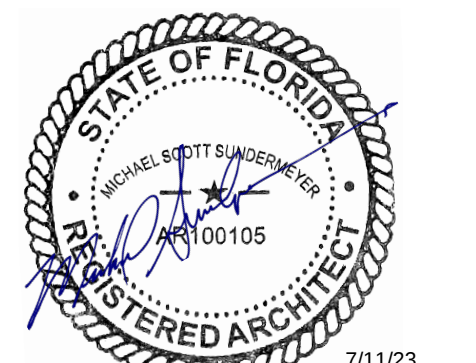


PROFESSIONAL OF RECORD
MICHAEL SCOTT SUNDERMEYER
License No. AR100105
Expiration Date 02/28/25
ALL WORK PREPARED ON THIS DRAWING PRIOR TO 02/28/2023 WAS
COMPLETED UNDER THE DIRECT SUPERVISION OF
JAMES A. SCHMITT, LICENSE NO. AR00058
REVISIONS TO THIS PROJECT AFTER 03/01/2023 HAVE BEEN
COMPLETED UNDER THE DIRECT SUPERVISION OF THE
PROFESSIONAL LISTED IN THE TITLE BLOCK


Drawn By/Checked By:	MTT/MSB
Project Number	2100630
Owner & Permit Date	09/21/21
Bid Date	04/20/22

LIFE SAFETY
PLAN

A0.1

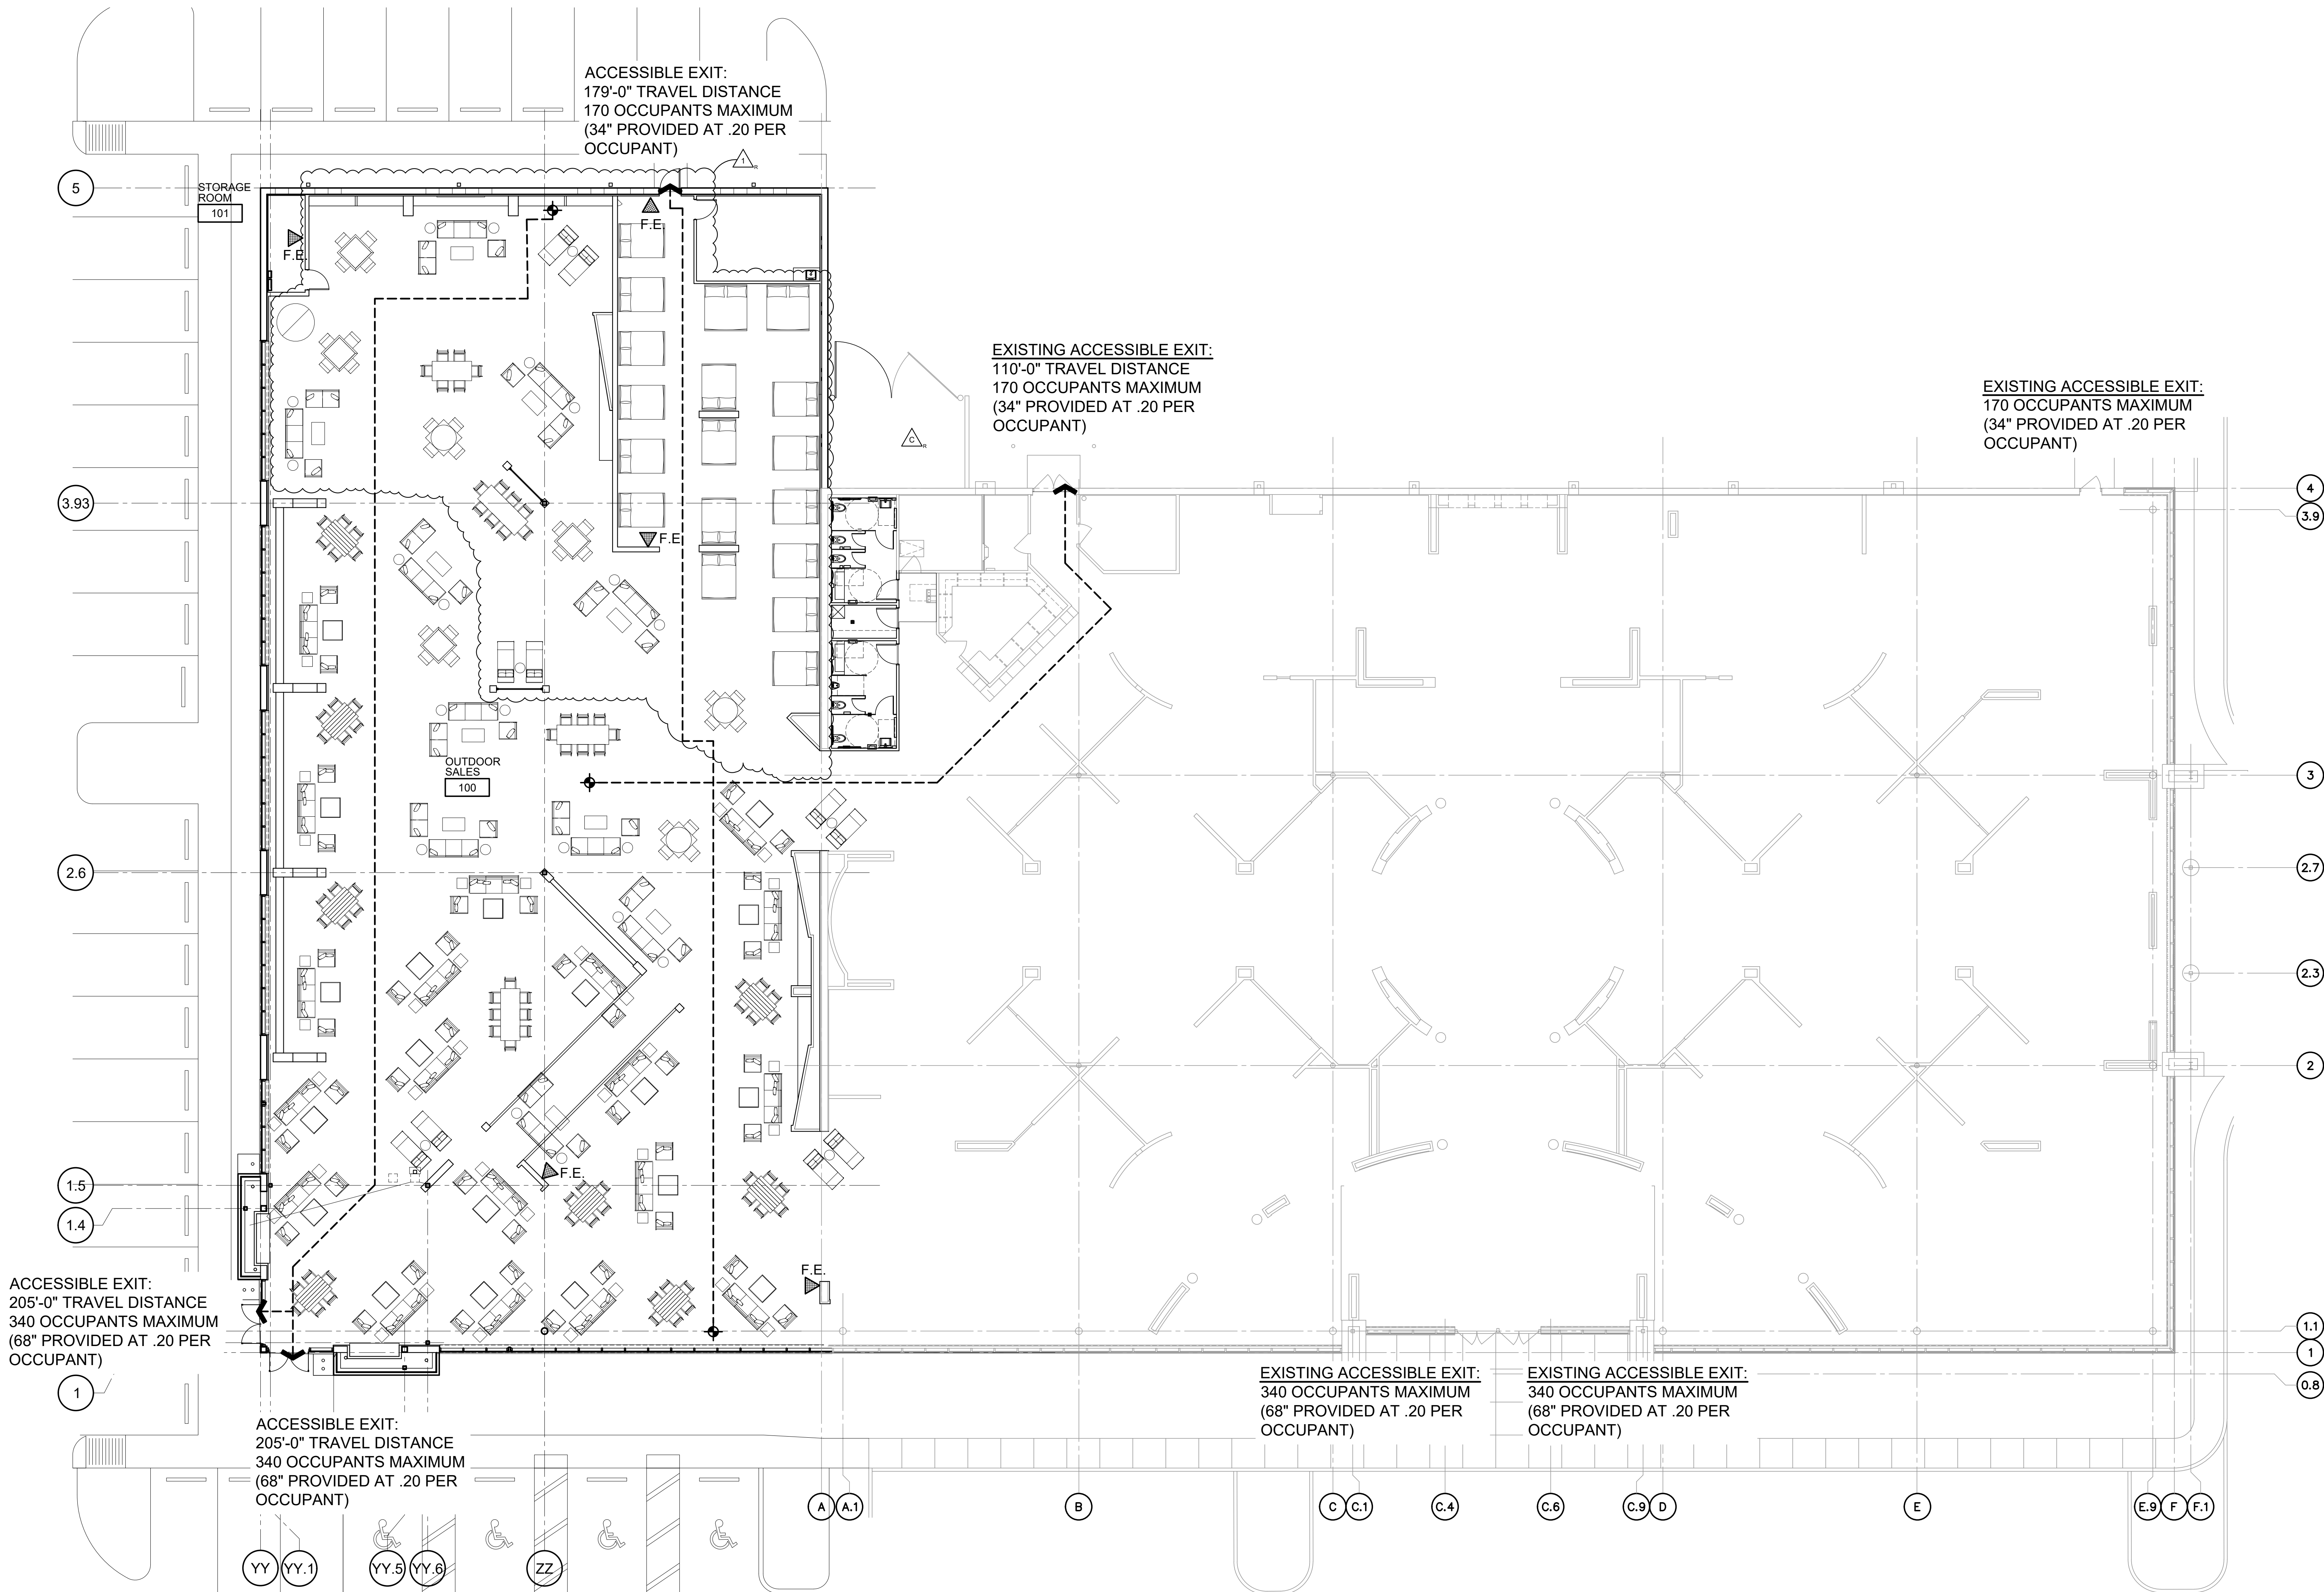

1 LIFE SAFETY PLAN
A0.1 SCALE: 3/32" = 1'-0"



EXITING REQUIREMENTS:

PER SECTION (1005.1) - 889 TOTAL OCCUPANTS x 0.20 = 133.8" TOTAL
REQUIRED EXIT WIDTH

TOTAL PROVIDED EXIT WIDTH = 374"
MAXIMUM TRAVEL DISTANCE WITH SPRINKLER SYSTEM: 250'

FIRE EXTINGUISHER NOTES:

F.E. ▲ FIRE EXTINGUISHERS (5 TOTAL)
- MOUNT TO FREESTANDING SALES CENTER MILLWORK IN
SHOWROOM AREAS. COORDINATE REQUIREMENTS WITH OWNER.

NEW ADDITION REQUIREMENTS:
- 1 FIRE EXTINGUISHER REQUIRED FOR EVERY 3000 SQUARE FEET.
- AT 14,654 SQUARE FEET / 3000 = 5 TOTAL EXTINGUISHERS
REQUIRED > (5) PROVIDED

GENERAL FIRE PROTECTION NOTES:

- BUILDING IS TO BE FULLY PROTECTED WITH AUTOMATIC
SPRINKLER SYSTEM
- PROVIDE FIRE EXTINGUISHERS AS SHOWN ON PLAN.
- PROVIDE ADDITIONAL FIRE EXTINGUISHERS AS REQUIRED BY THE
FIRE MARSHAL, COORDINATE MOUNTING REQUIREMENTS WITH
OWNER.
- PROVIDE PORTABLE FIRE EXTINGUISHERS IN ACCORDANCE WITH
NFPA 10.
- SALES FLOOR FIRE EXTINGUISHERS ARE TO BE MOUNTED TO THE
OWNER PROVIDED FREESTANDING SALES CENTER CABINETS ON THE
SIDE OPPOSITE THE PHONE. DO NOT MOUNT TO THE WALLS IN THE
SALES FLOOR AREA