




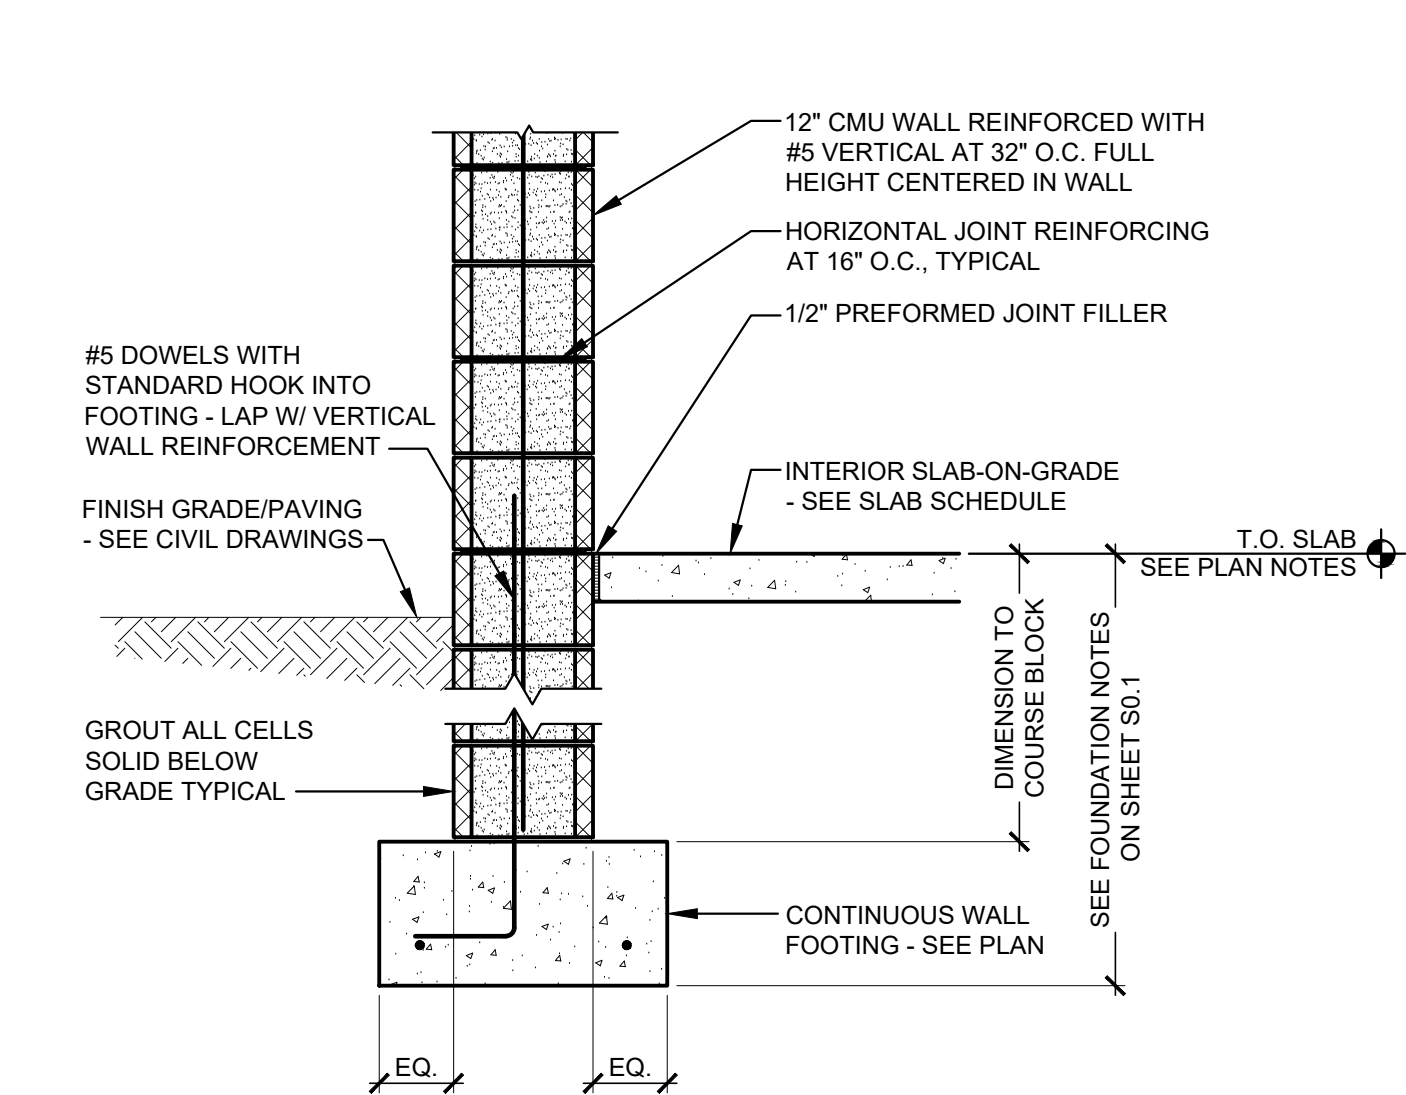


1 SECTION
SCALE: 3/4" = 1'-0"

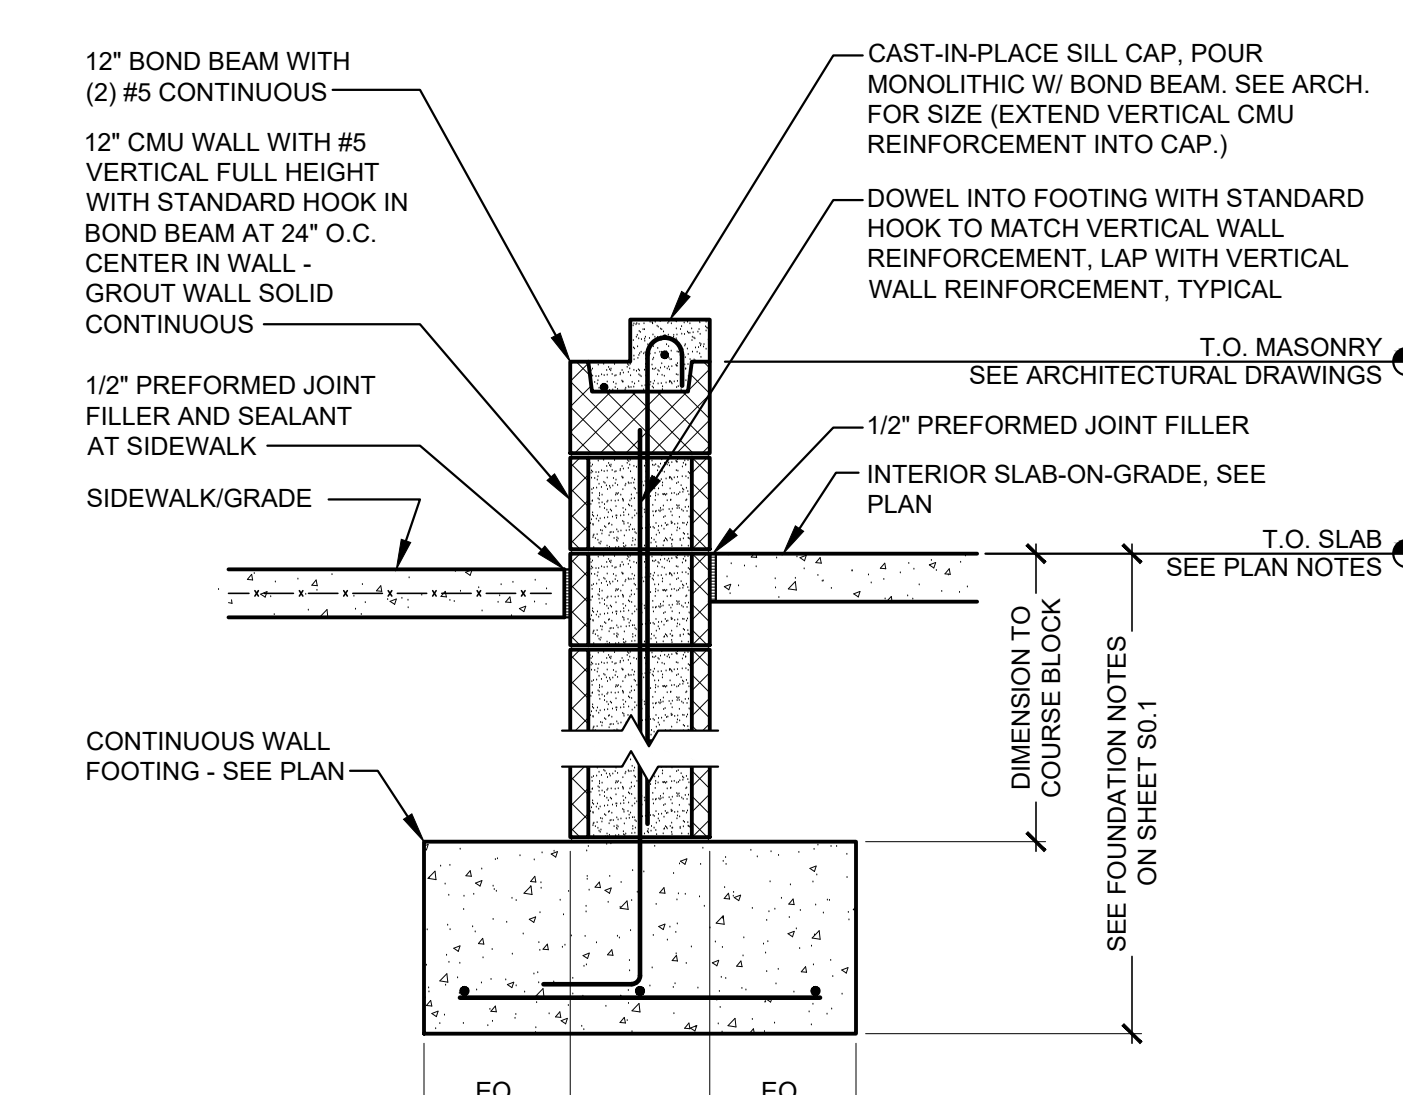


2 SECTION
SCALE: 3/4" = 1'-0"

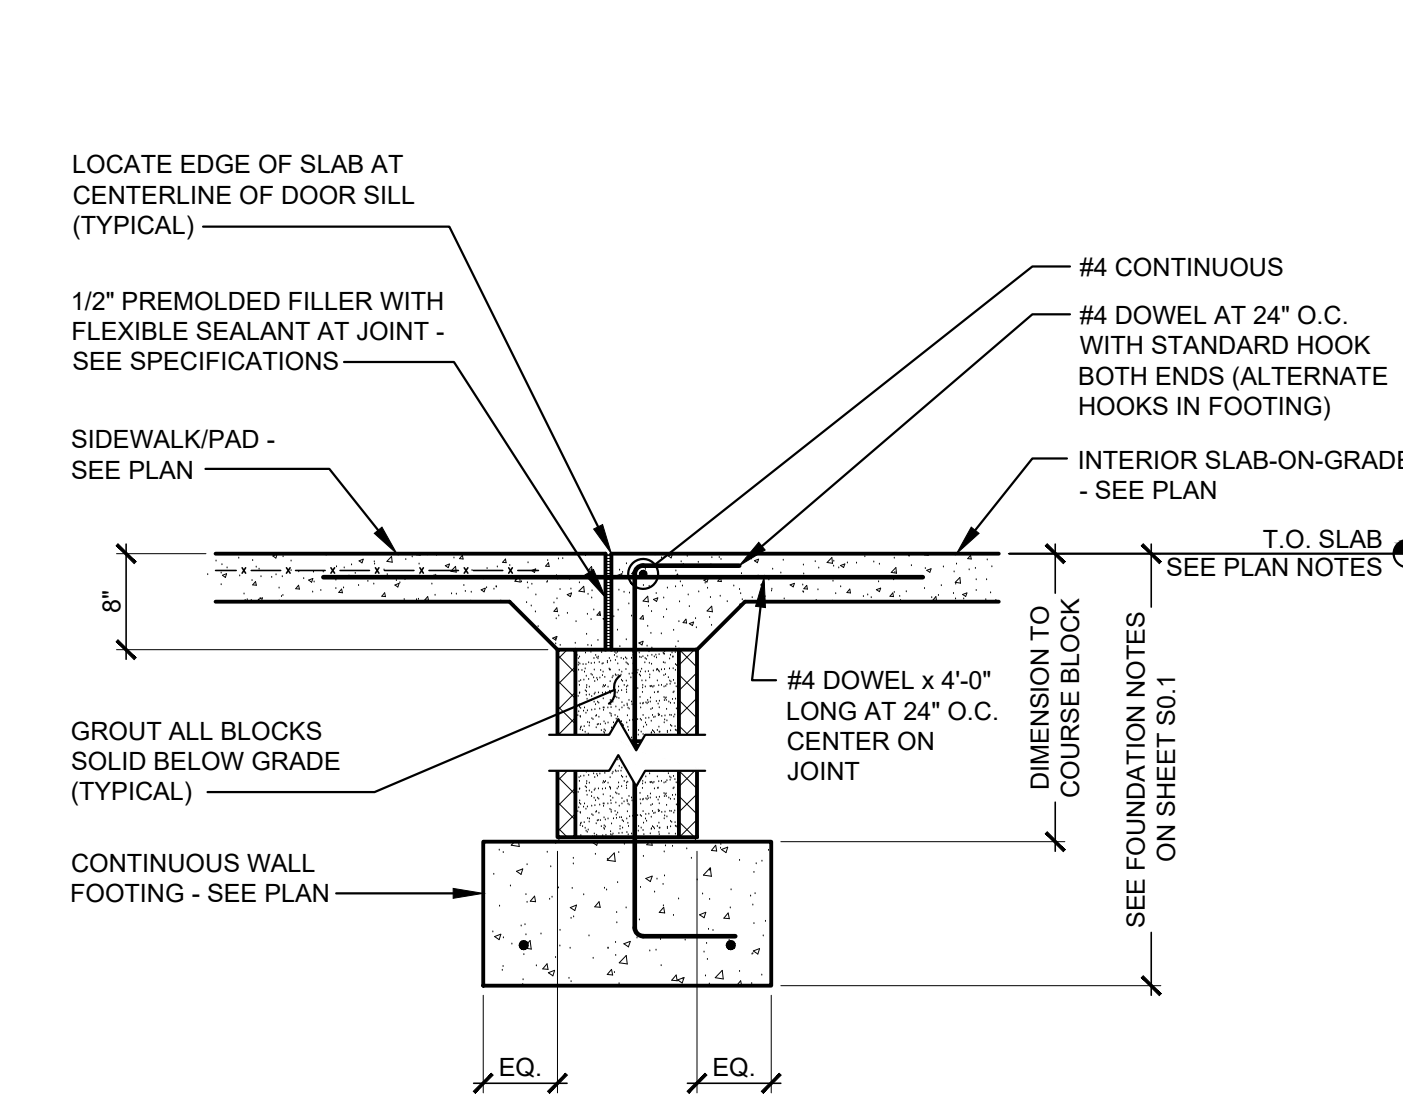


3 SECTION
SCALE: 3/4" = 1'-0"

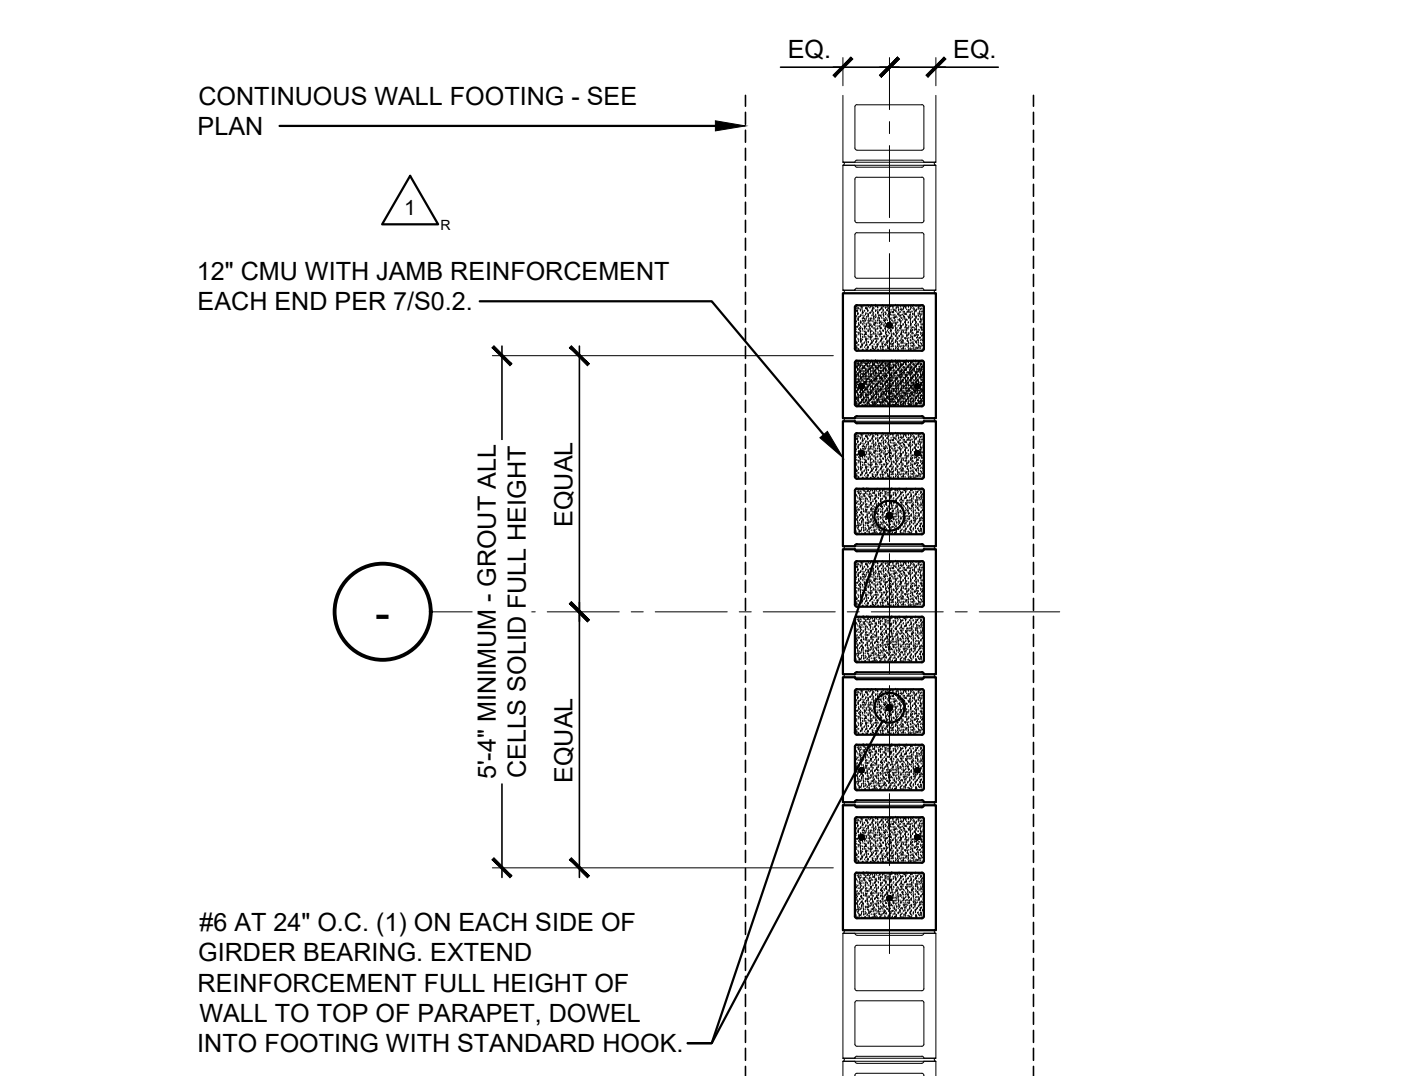


4 PLAN DETAIL
SCALE: 1/2" = 1'-0"

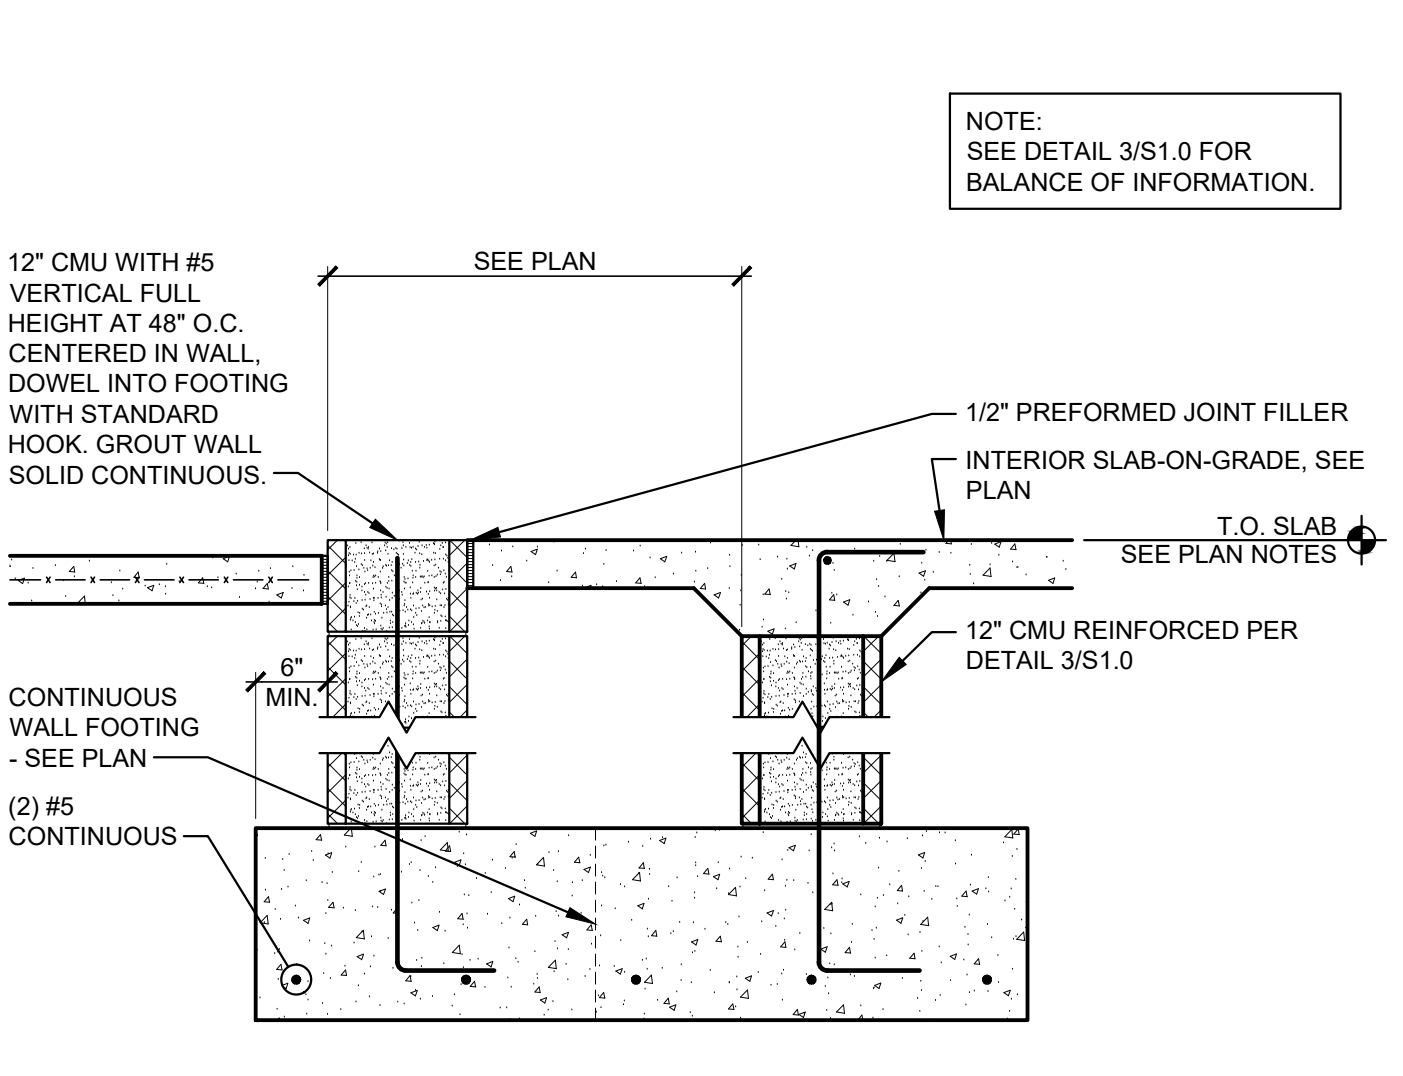


5 SECTION
SCALE: 3/4" = 1'-0"

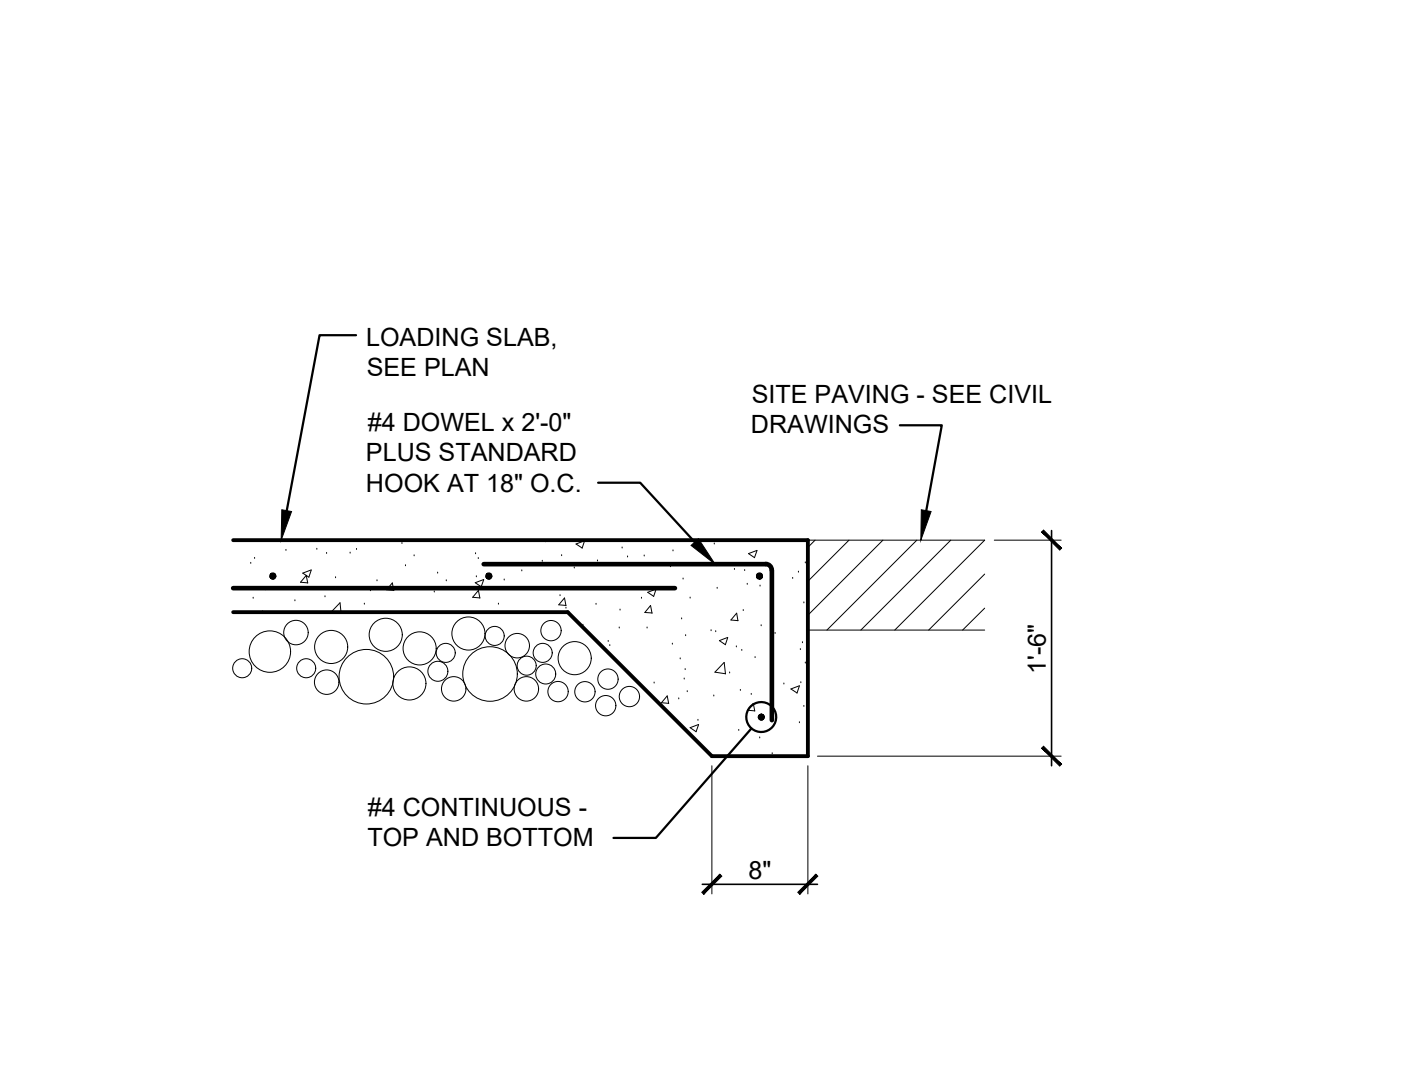


6 SECTION
SCALE: 3/4" = 1'-0"

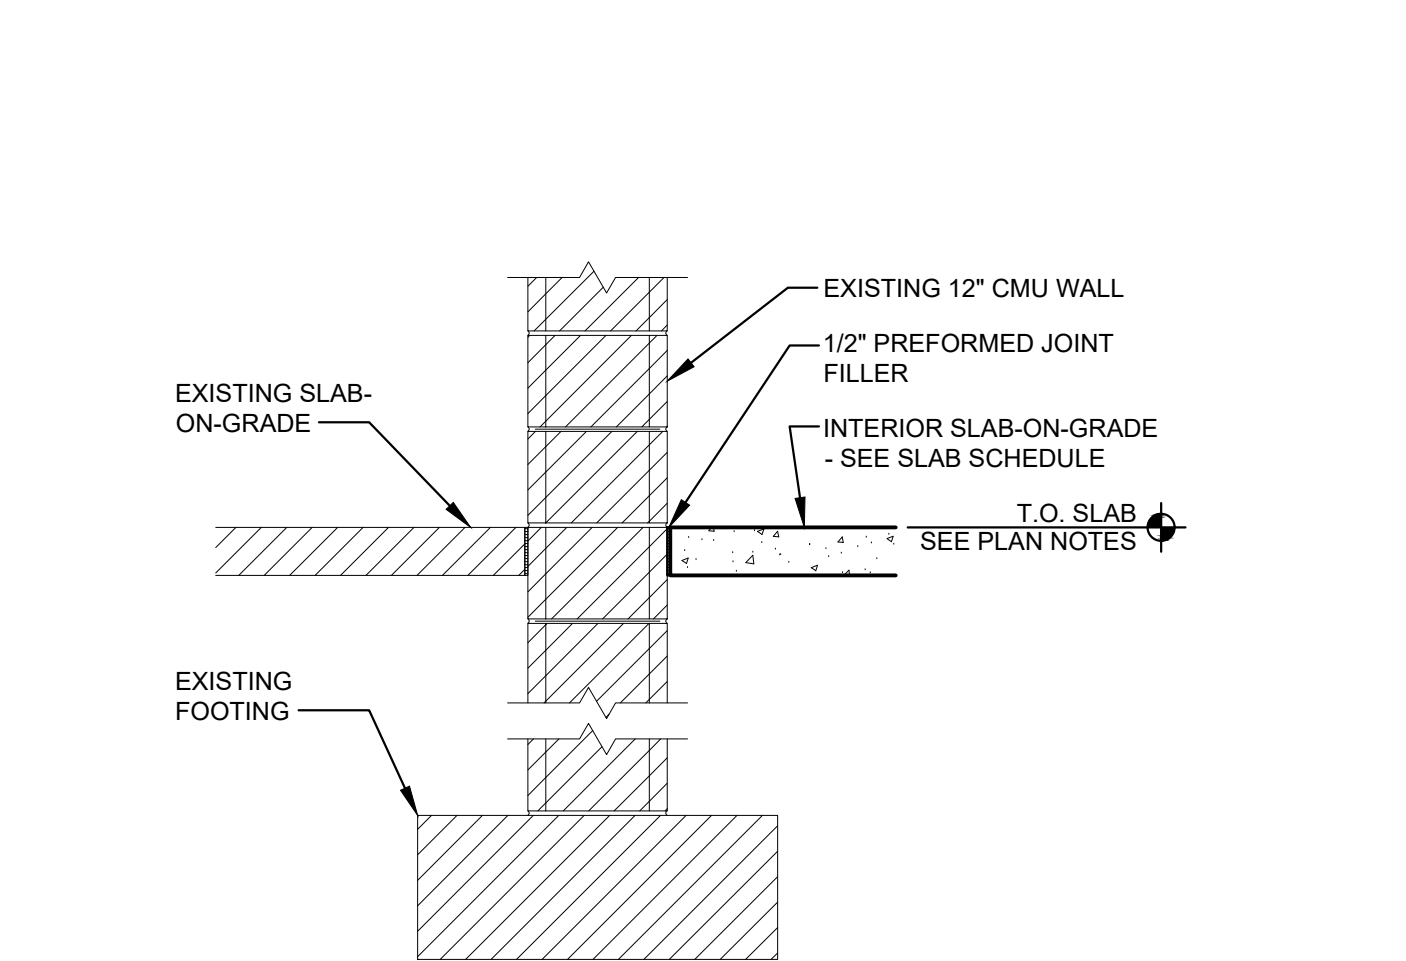


7 SECTION
SCALE: 3/4" = 1'-0"

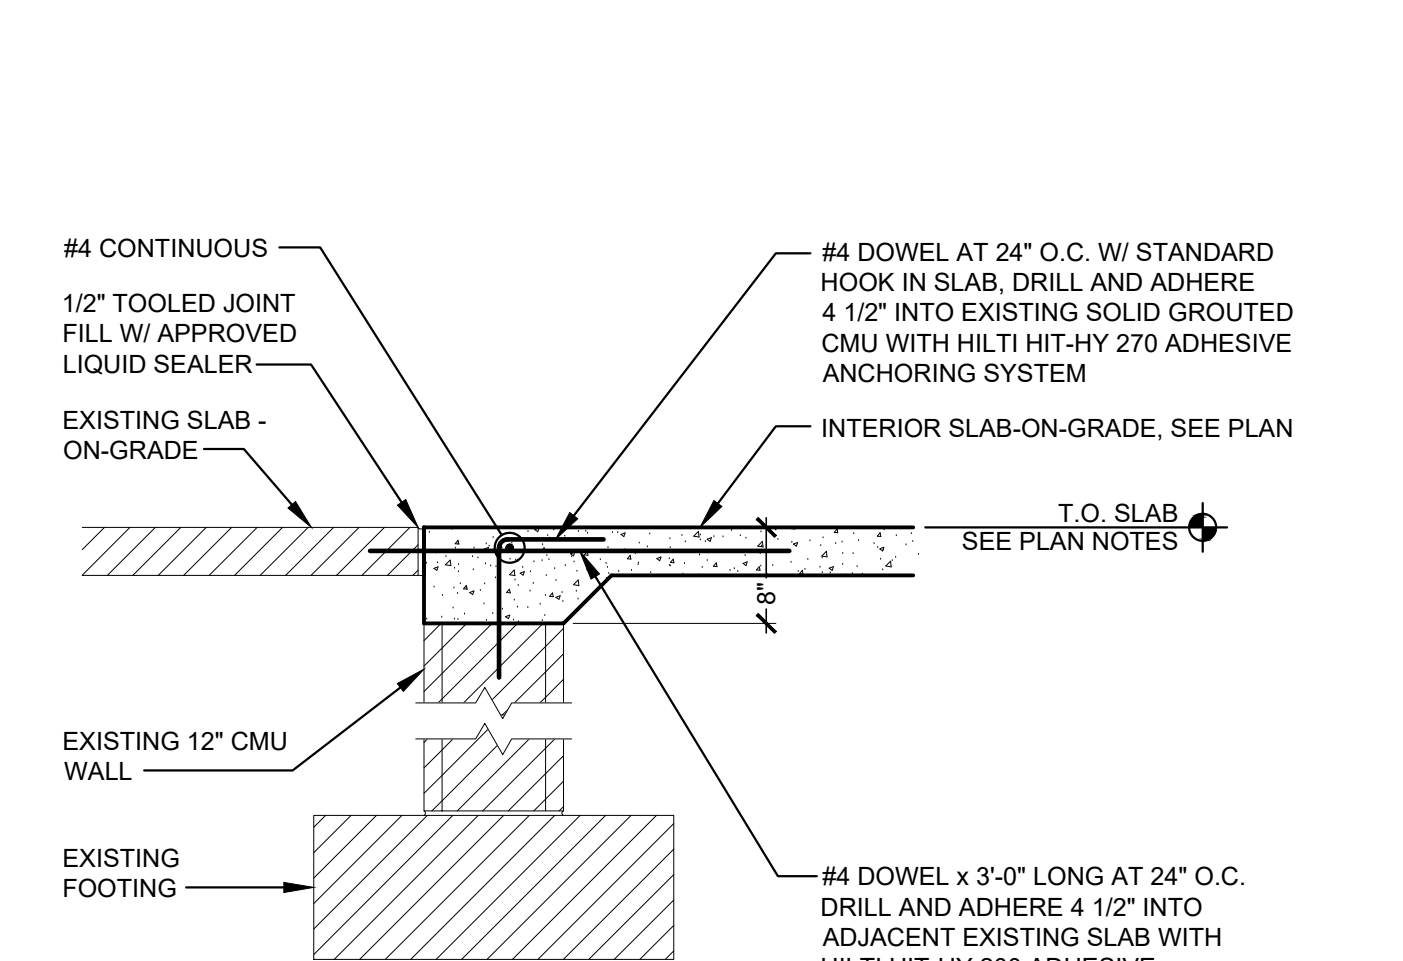


8 SECTION
SCALE: 3/4" = 1'-0"

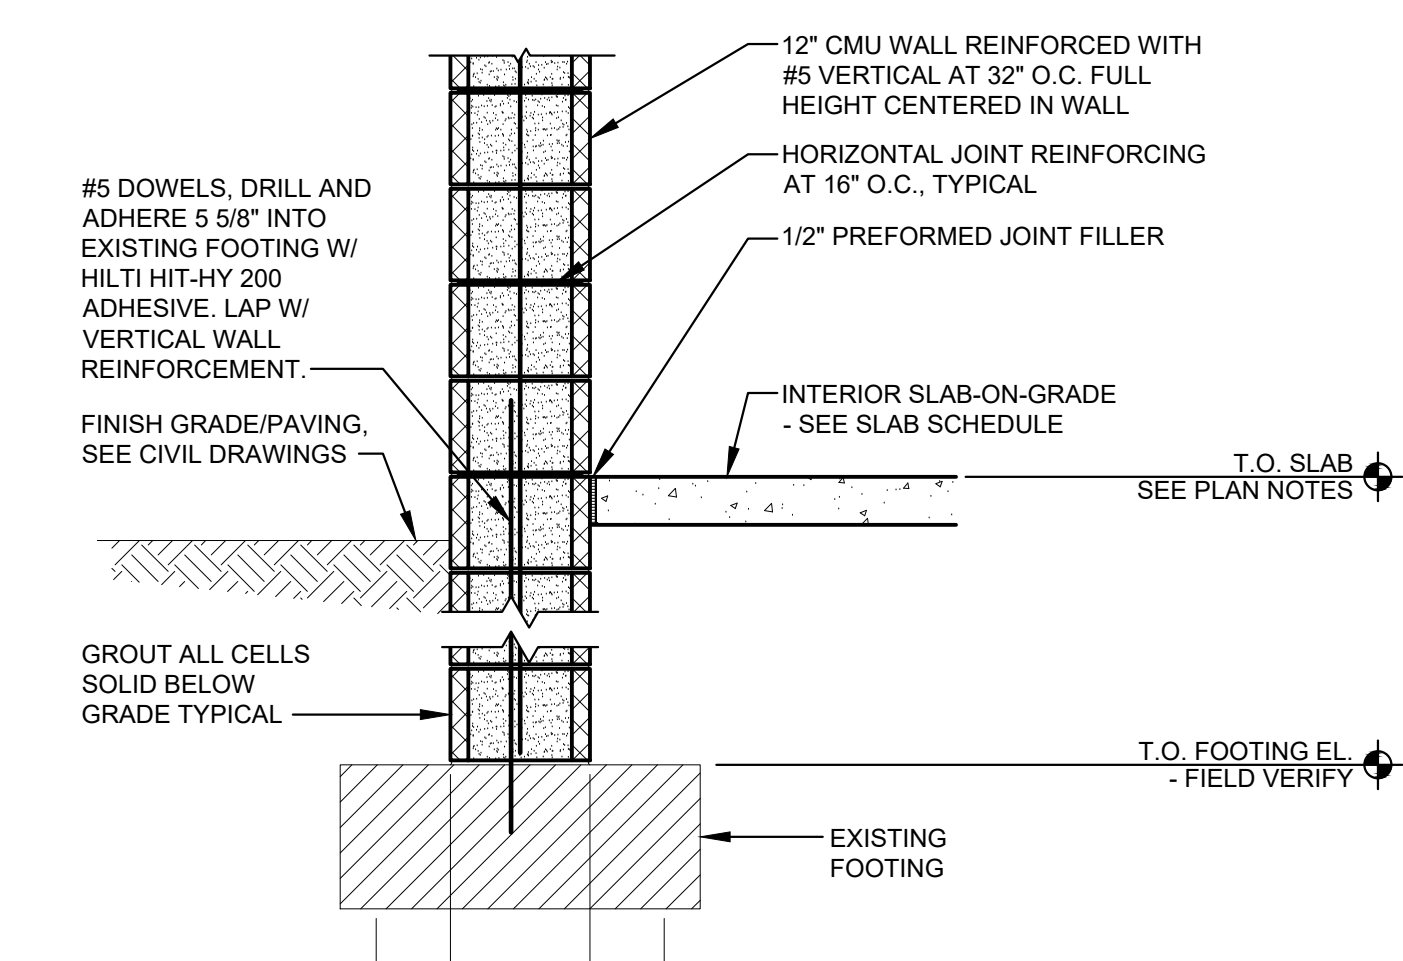

9 SECTION
SCALE: 3/4" = 1'-0"

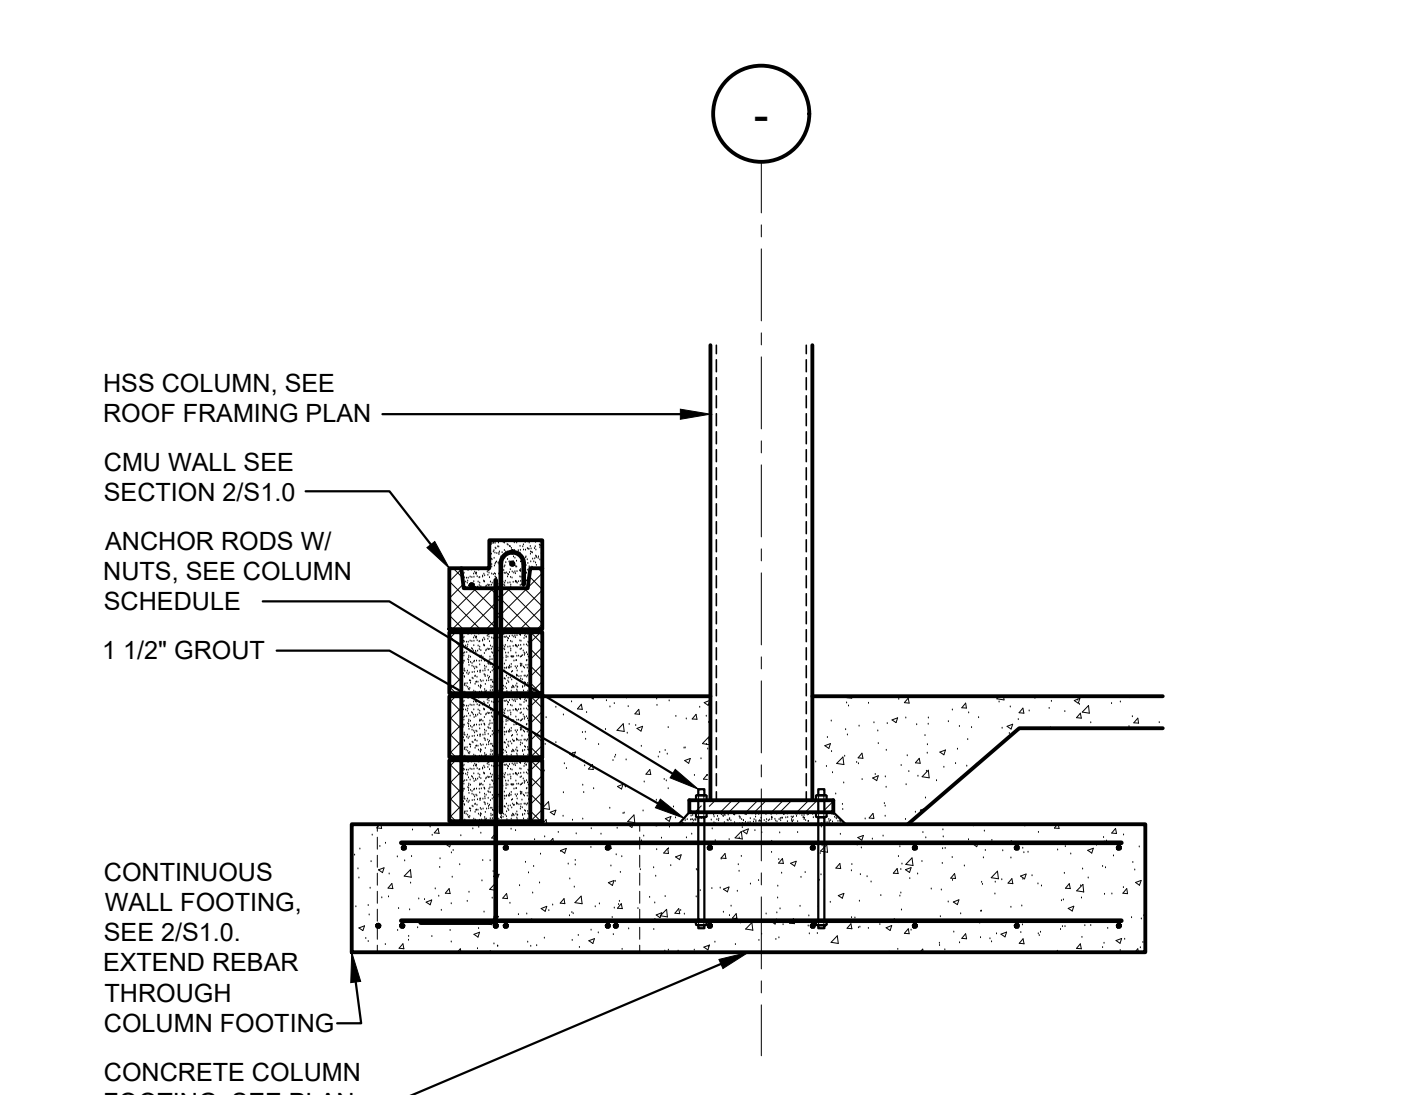

11 SECTION
SCALE: 1/2" = 1'-0"

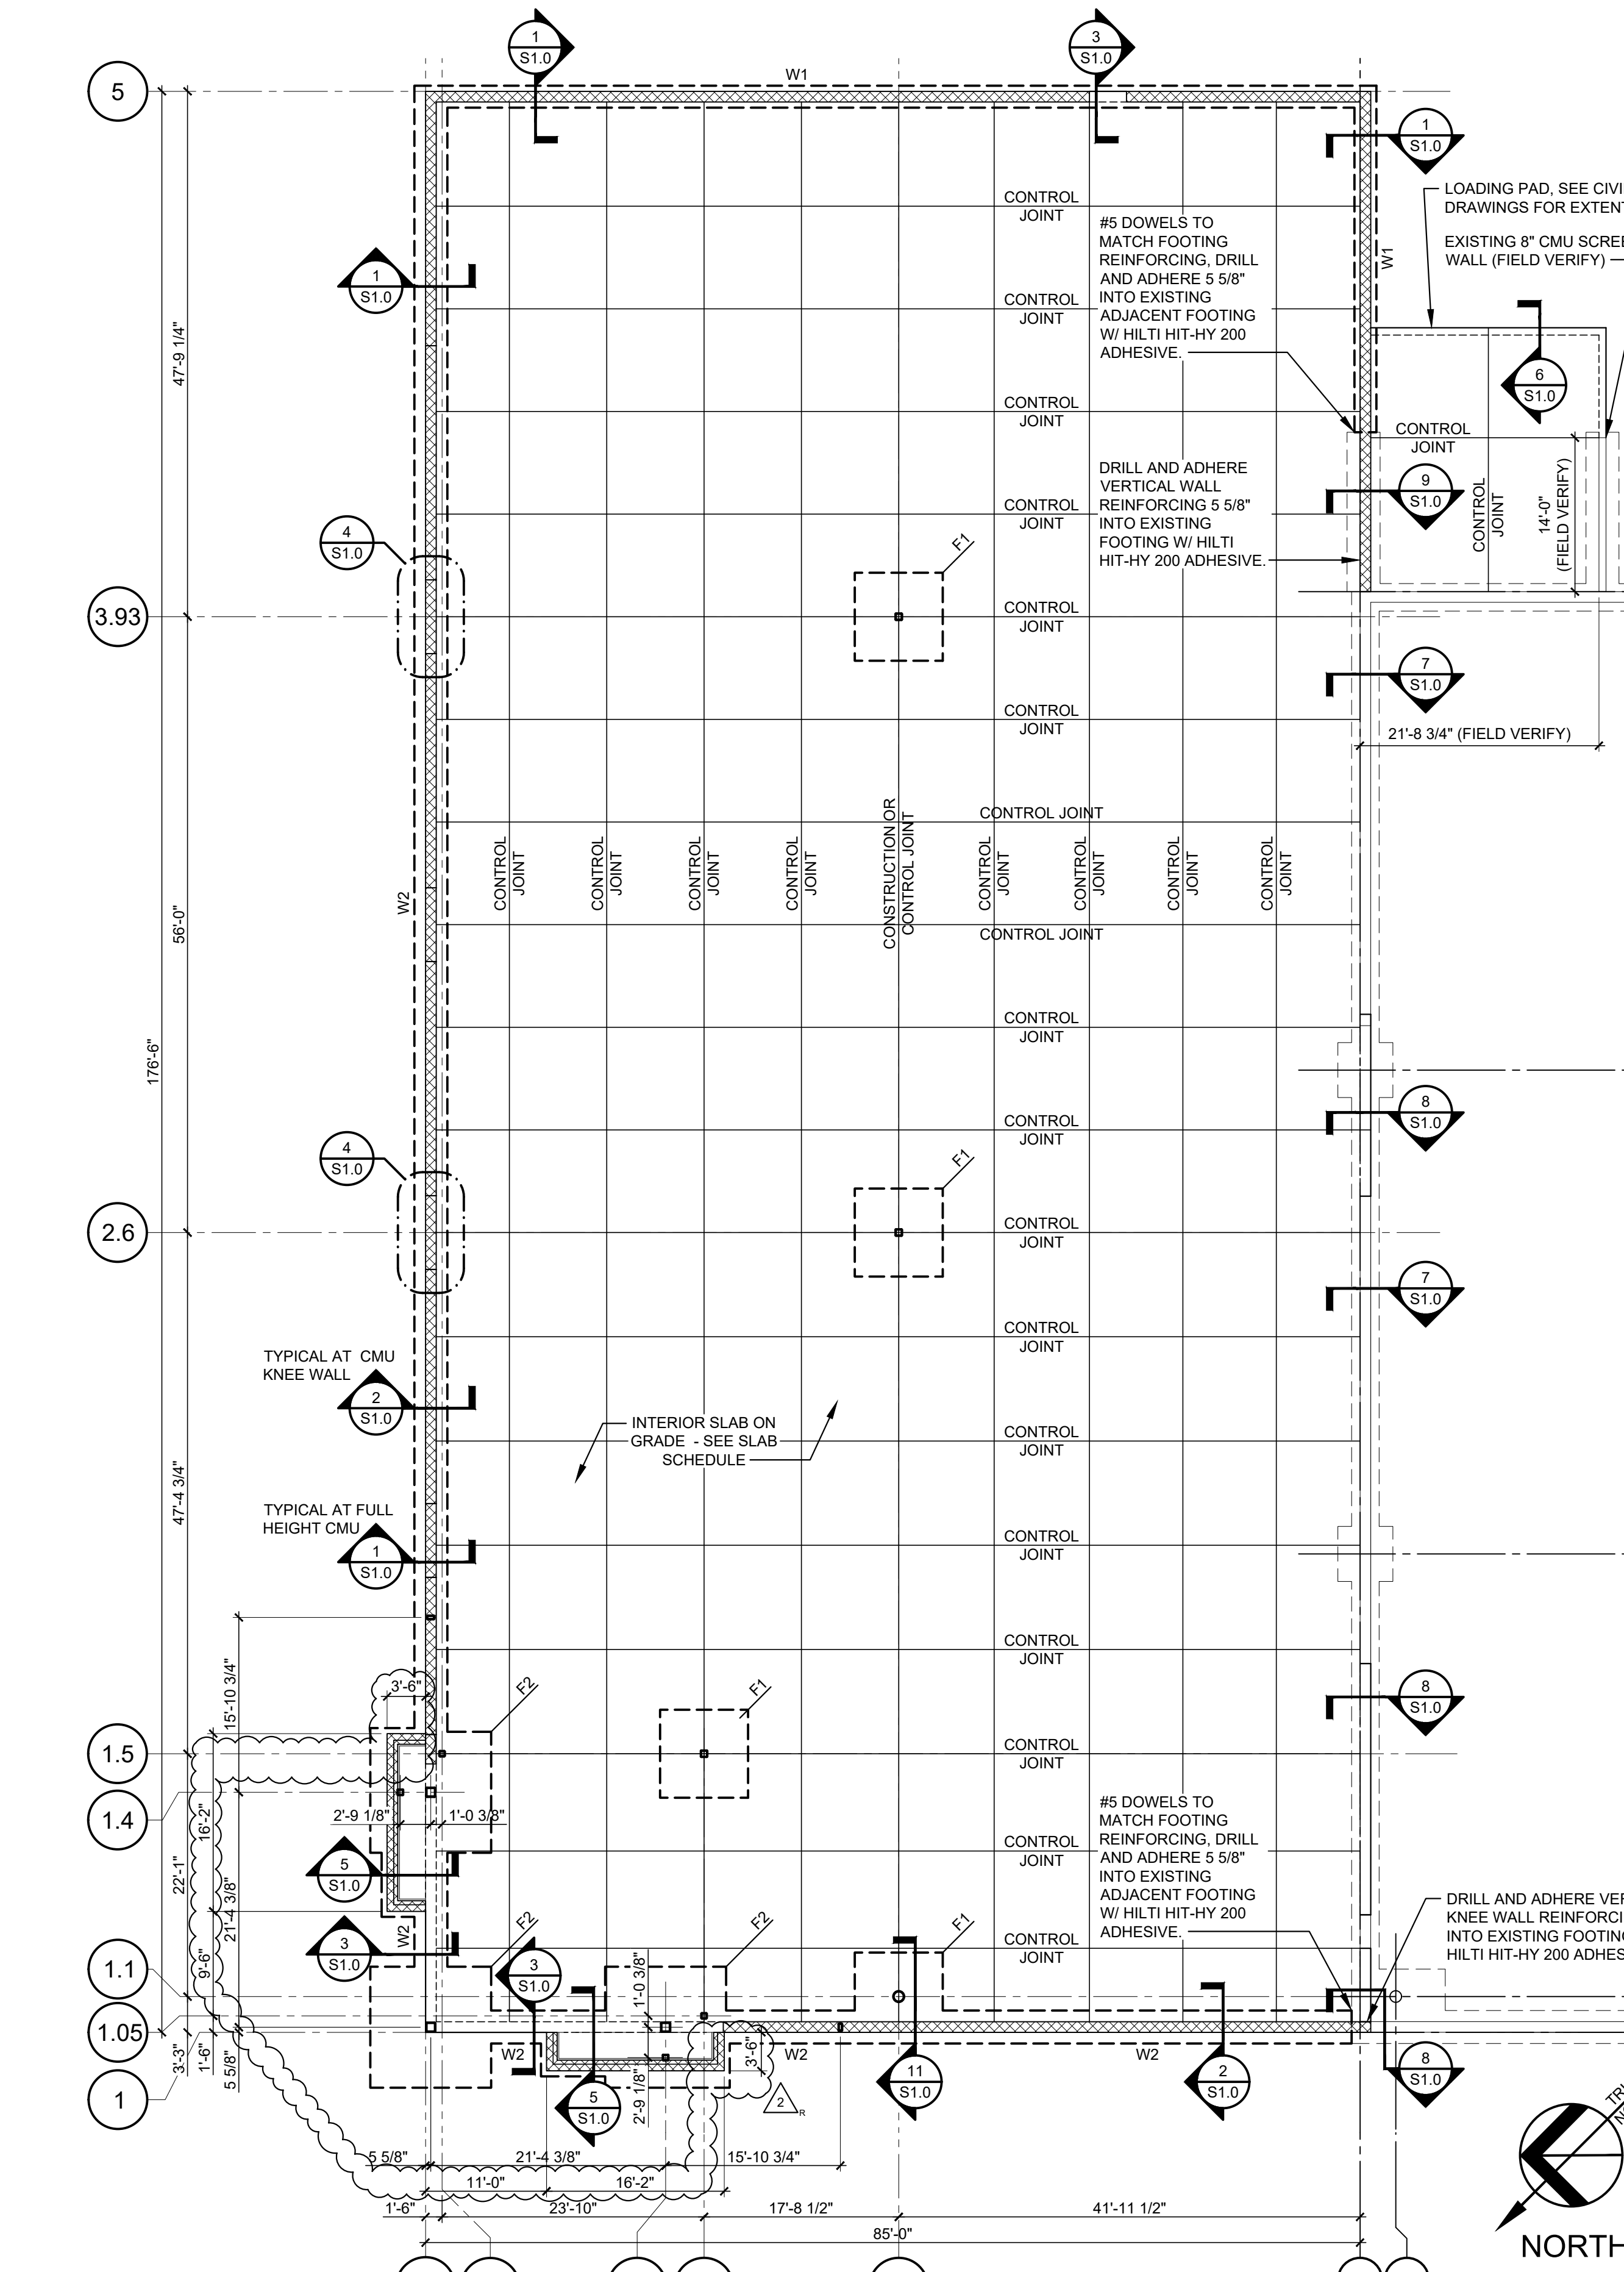


10 FOUNDATION PLAN
SCALE: 3/32" = 1'-0"

SLAB SCHEDULE		
LOCATION	THICKNESS* AND REINFORCING	REMARKS
INTERIOR SLAB ON GRADE	4" CONCRETE SLAB ON GRADE REINFORCED WITH MINIMUM 1.0 LBS/YARD POLYPROPYLENE, FIBRILLATED FIBERS - SEE PROJECT SPECIFICATIONS	VAPOR RETARDER PER SPECIFICATION OVER COMPACTED SUB-GRADE PER GEOTECHNICAL REPORT
SIDEWALK	4" CONCRETE SLAB ON GRADE REINFORCED WITH MINIMUM 1.0 LBS/YARD POLYPROPYLENE, FIBRILLATED FIBERS - SEE PROJECT SPECIFICATIONS	COMPACTED SUBBASE PER GEOTECHNICAL REPORT. SEE ARCHITECTURAL DRAWINGS FOR SLAB JOINTS AND PLAN LAYOUT
LOADING PAD	6" CONCRETE SLAB ON GRADE REINFORCED WITH #4 BARS AT 18" O.C. EACH WAY - CENTER	COMPACTED SUBBASE PER PROJECT GEOTECHNICAL REPORT

* THICKNESS OF SLABS AS SPECIFIED IN SCHEDULE ARE MINIMUMS. THERE SHALL BE NO TOLERANCE FOR SLABS THINNER THAN THOSE SPECIFIED IN SCHEDULE.

FOUNDATION PLAN NOTES		
1.	SEE SHEET S0.1 FOR GENERAL NOTES AND TYPICAL DETAILS	
2.	ALL ELEVATIONS BASED ON FINISH FLOOR ELEVATION = 100'-0" FOR REFERENCE ONLY. SEE SITE PLAN FOR ACTUAL FINISH FLOOR ELEVATIONS.	
3.	TOP OF INTERIOR FOOTING (TIF) = 98'-4" UNLESS NOTED OTHERWISE ON PLAN. SEE GENERAL STRUCTURAL NOTES FOR TOP OF EXTERIOR FOOTING ELEVATIONS. THE GENERAL CONTRACTOR SHALL COORDINATE ALL TOP OF FOOTING ELEVATIONS WITH THE CIVIL ENGINEERING DRAWINGS AND SITE CONDITIONS. FOOTINGS SHALL BE STEPPED IN ACCORDANCE WITH THE TYPICAL STEPPED FOOTING DETAIL.	
4.	CENTER ALL FOOTINGS ON COLUMN AND WALL CENTERLINES, UNLESS NOTED OTHERWISE.	
5.	CONTINUOUS WALL FOOTING REINFORCING SHALL BE PLACED CONTINUOUS THROUGH ISOLATED COLUMN FOOTINGS.	
6.	SEE ARCHITECTURAL PLANS AND DETAILS FOR TYPICAL INTERIOR WALL PARTITION SUPPORTS THAT PENETRATE SLAB.	

FOOTING SCHEDULE		
MARK	SIZE	REINFORCING
W1	2'-0" x 1'-0" x CONTINUOUS	(2) #5 CONTINUOUS - BOTTOM
W2	3'-0" x 1'-4" x CONTINUOUS	(3) #5 CONTINUOUS - BOTTOM
F1	8'-0" x 8'-0" x 1'-4"	(8) #5 EACH WAY - TOP & BOTTOM
F2	11'-0" x 11'-0" x 1'-4"	(11) #5 EACH WAY - TOP & BOTTOM

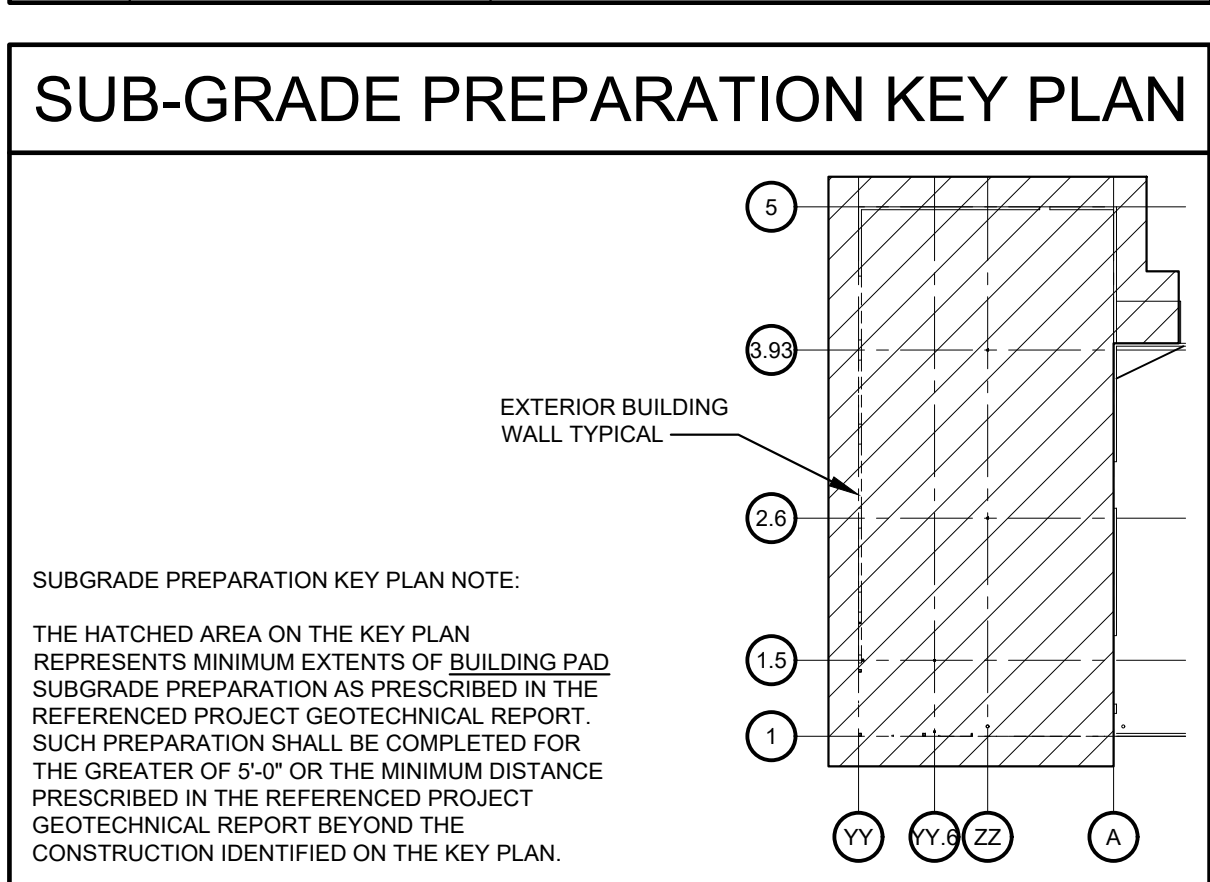

PROFESSIONAL OF RECORD
MARK A. SPALINGER
License No. 03586
Expiration Date 02/28/23

Drawn By/Checked By: MPD/MPD
Project Number 2100630
Owner & Permit Date 09/21/21
Bid Date 04/20/22

FOUNDATION PLAN
S1.0

ROOMS PATIO ADDITION
2832 SW COLLEGE ROAD
OCALA, FLORIDA 34474

CASCO
12 Sumner Drive, Suite 100, St. Louis, MO 63143 T: 314.821.1100